


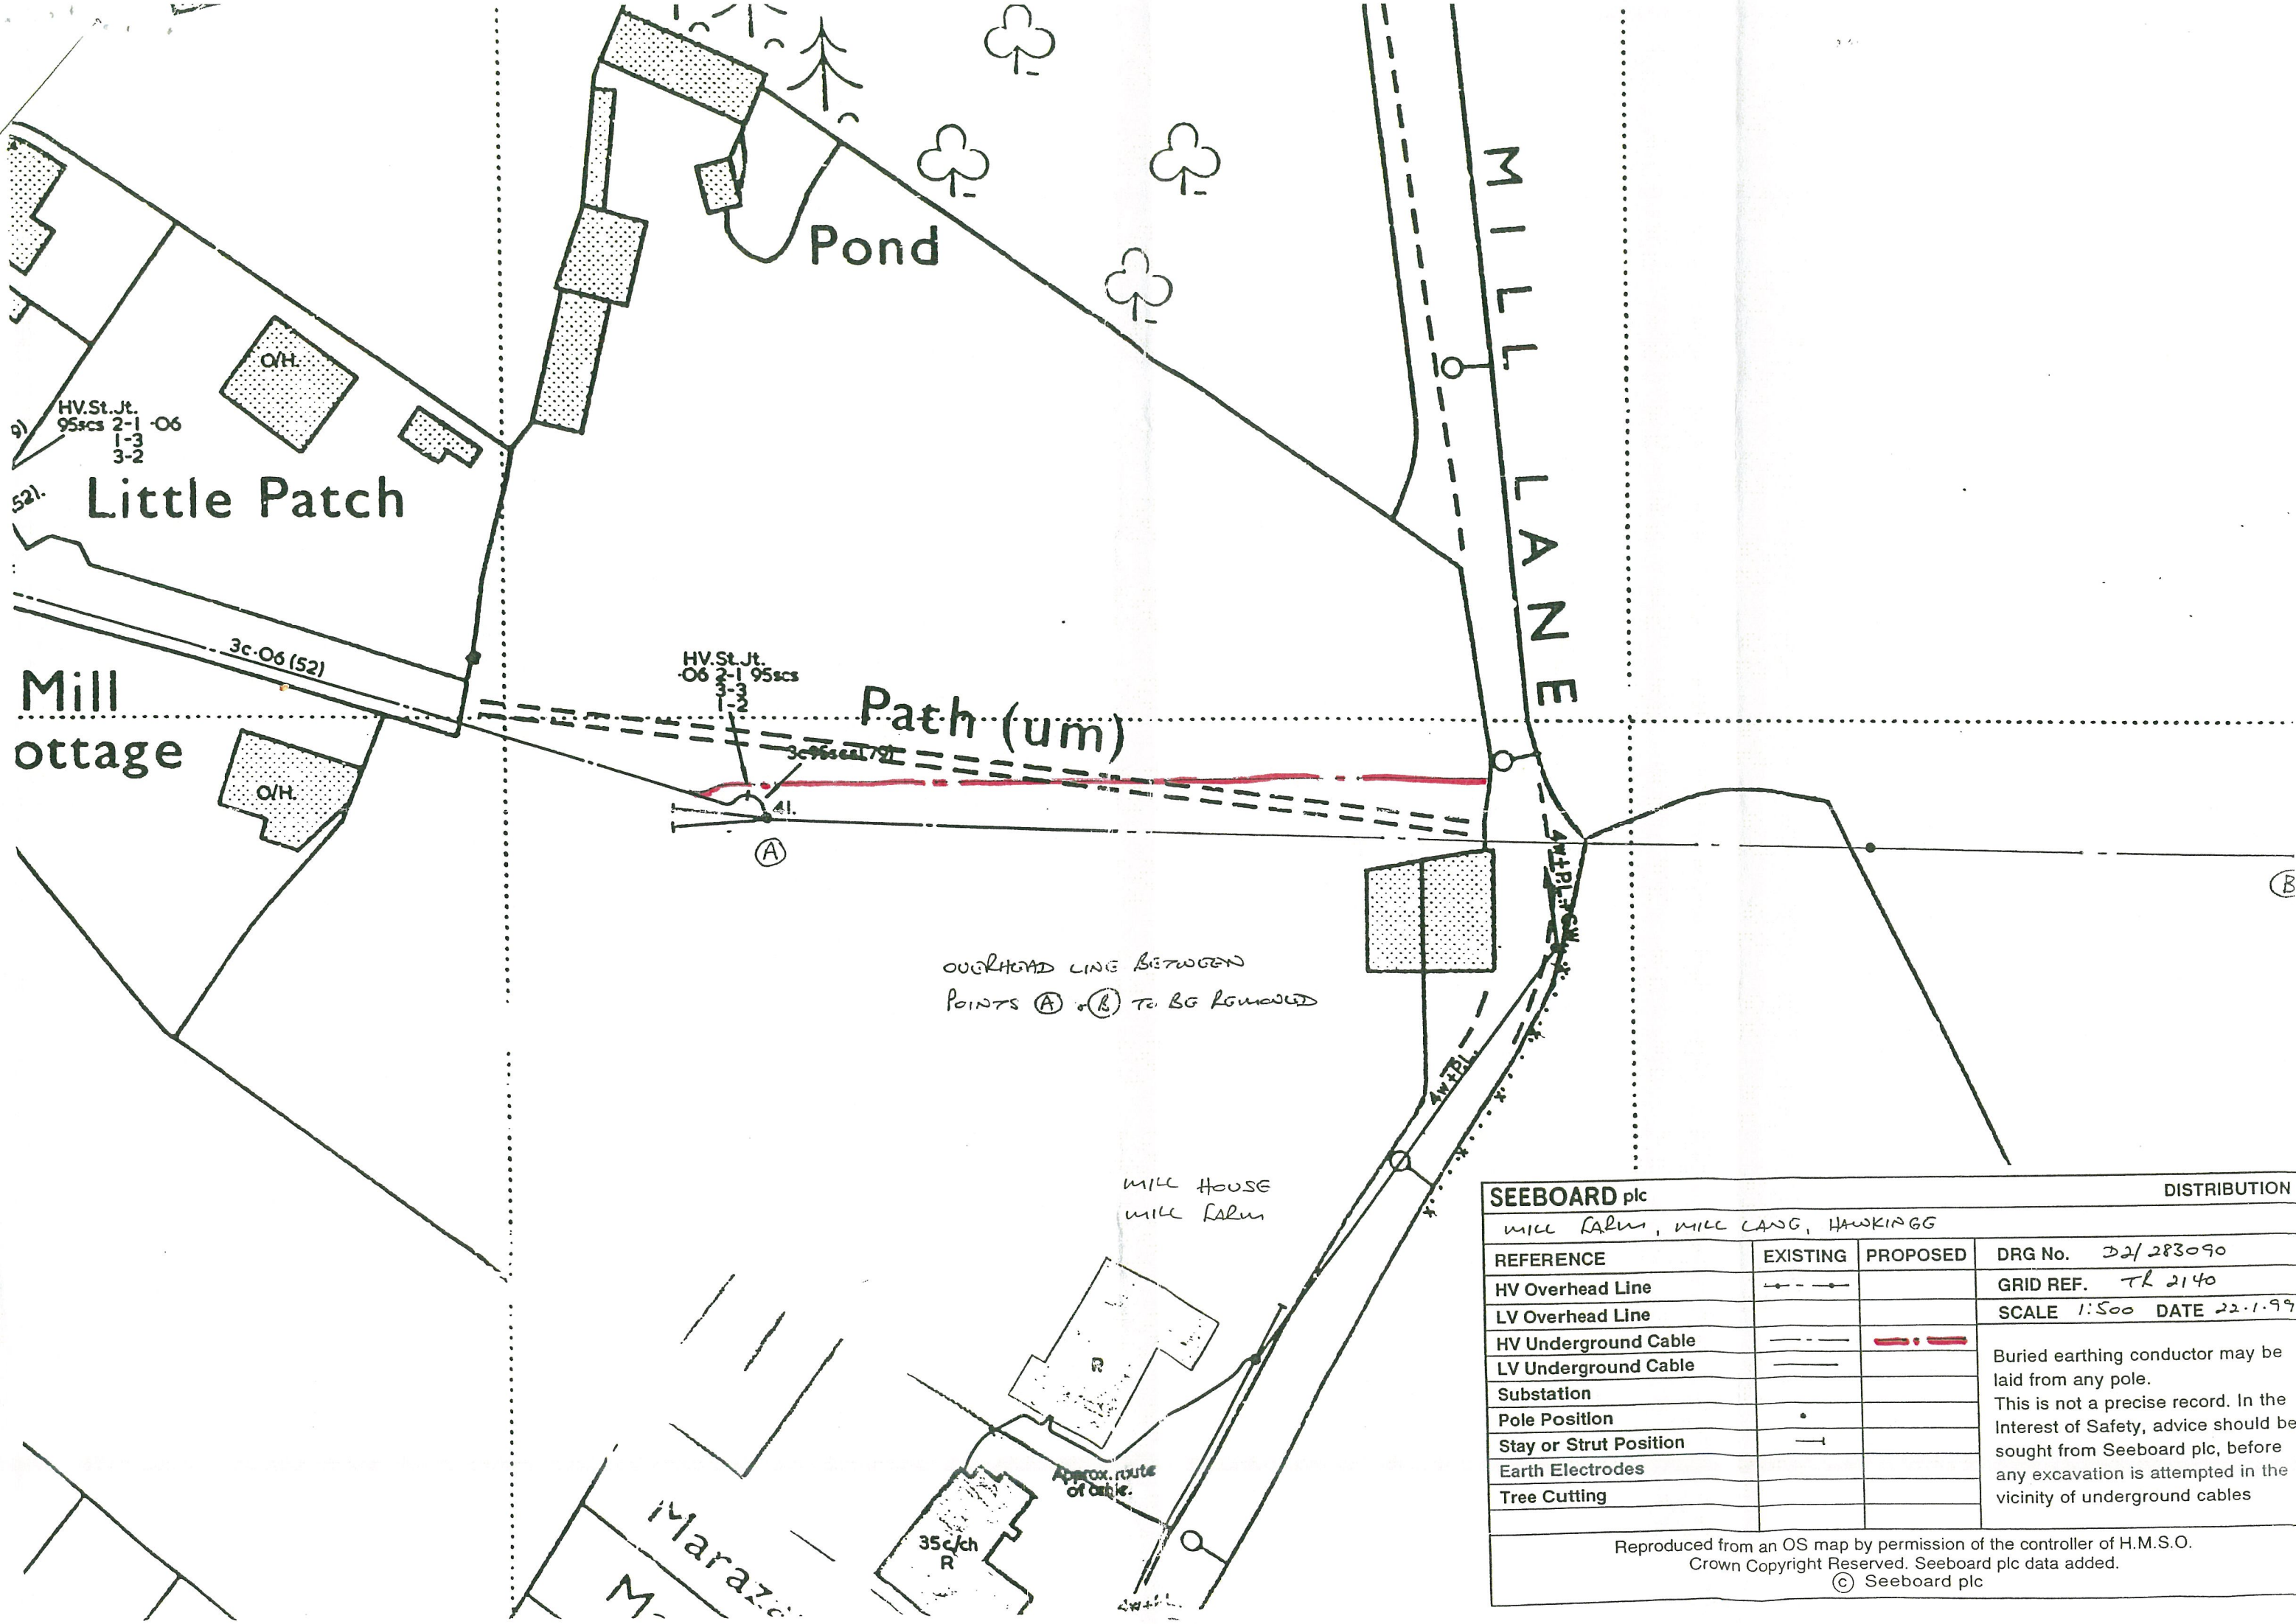

SEEBOARD plc			DISTRIBUTION
MILL FARM, MILL LANE, HAWKINGG			
REFERENCE	EXISTING	PROPOSED	DRG No. 32/283090
HV Overhead Line	---		GRID REF. TL 2140
LV Overhead Line			SCALE 1:500 DATE 22.1.99
HV Underground Cable	---	---	Buried earthing conductor may be laid from any pole. This is not a precise record. In the Interest of Safety, advice should be sought from Seeboard plc, before any excavation is attempted in the vicinity of underground cables
LV Underground Cable	---		
Substation			
Pole Position	.		
Stay or Strut Position	---		
Earth Electrodes			
Tree Cutting			
Reproduced from an OS map by permission of the controller of H.M.S.O. Crown Copyright Reserved. Seeboard plc data added. © Seeboard plc			