

Network Quotation Ref: L23155701
Requester Reference: NONE

FAO: Susan White,
Utilities Connections Management Ltd
Mainetti House
Bedwell Road
Wrexham Industrial estate
Wrexham
LL13 0UT

St Lawrence House
Station Approach, Horley
Surrey
RH6 9HJ

Date: 18 July 2023
Network Contact: Michael Driver
Tel: 02394 283161
Fax:

Dear Susan White,

Re: PROPOSED DEVELOPMENT @, LAND OFF, SWANSTREE AVENUE, SITTINGBOURNE, KENT,
ME10 4QE

Thank you for your enquiry dated 18 July 2023, which we received on 18 July 2023.

The nearest relevant main is Low Pressure and 388 metre(s) from the site boundary.

Plan Attached: Yes

Gas Diversionary or abandonment works may be required. For Further details please write to SGN at the above address. Reinforcement of SGN network to support the proposed load is not anticipated.


For new supply/alteration/disconnection quotations please refer to www.scotiagasnetworks.co.uk. Go to Related Links to download relevant request form.

If you have any queries, please contact Michael Driver on the number above.

Yours sincerely

PP 
Leigh Keegan
(Network Support Manager)

L23155701

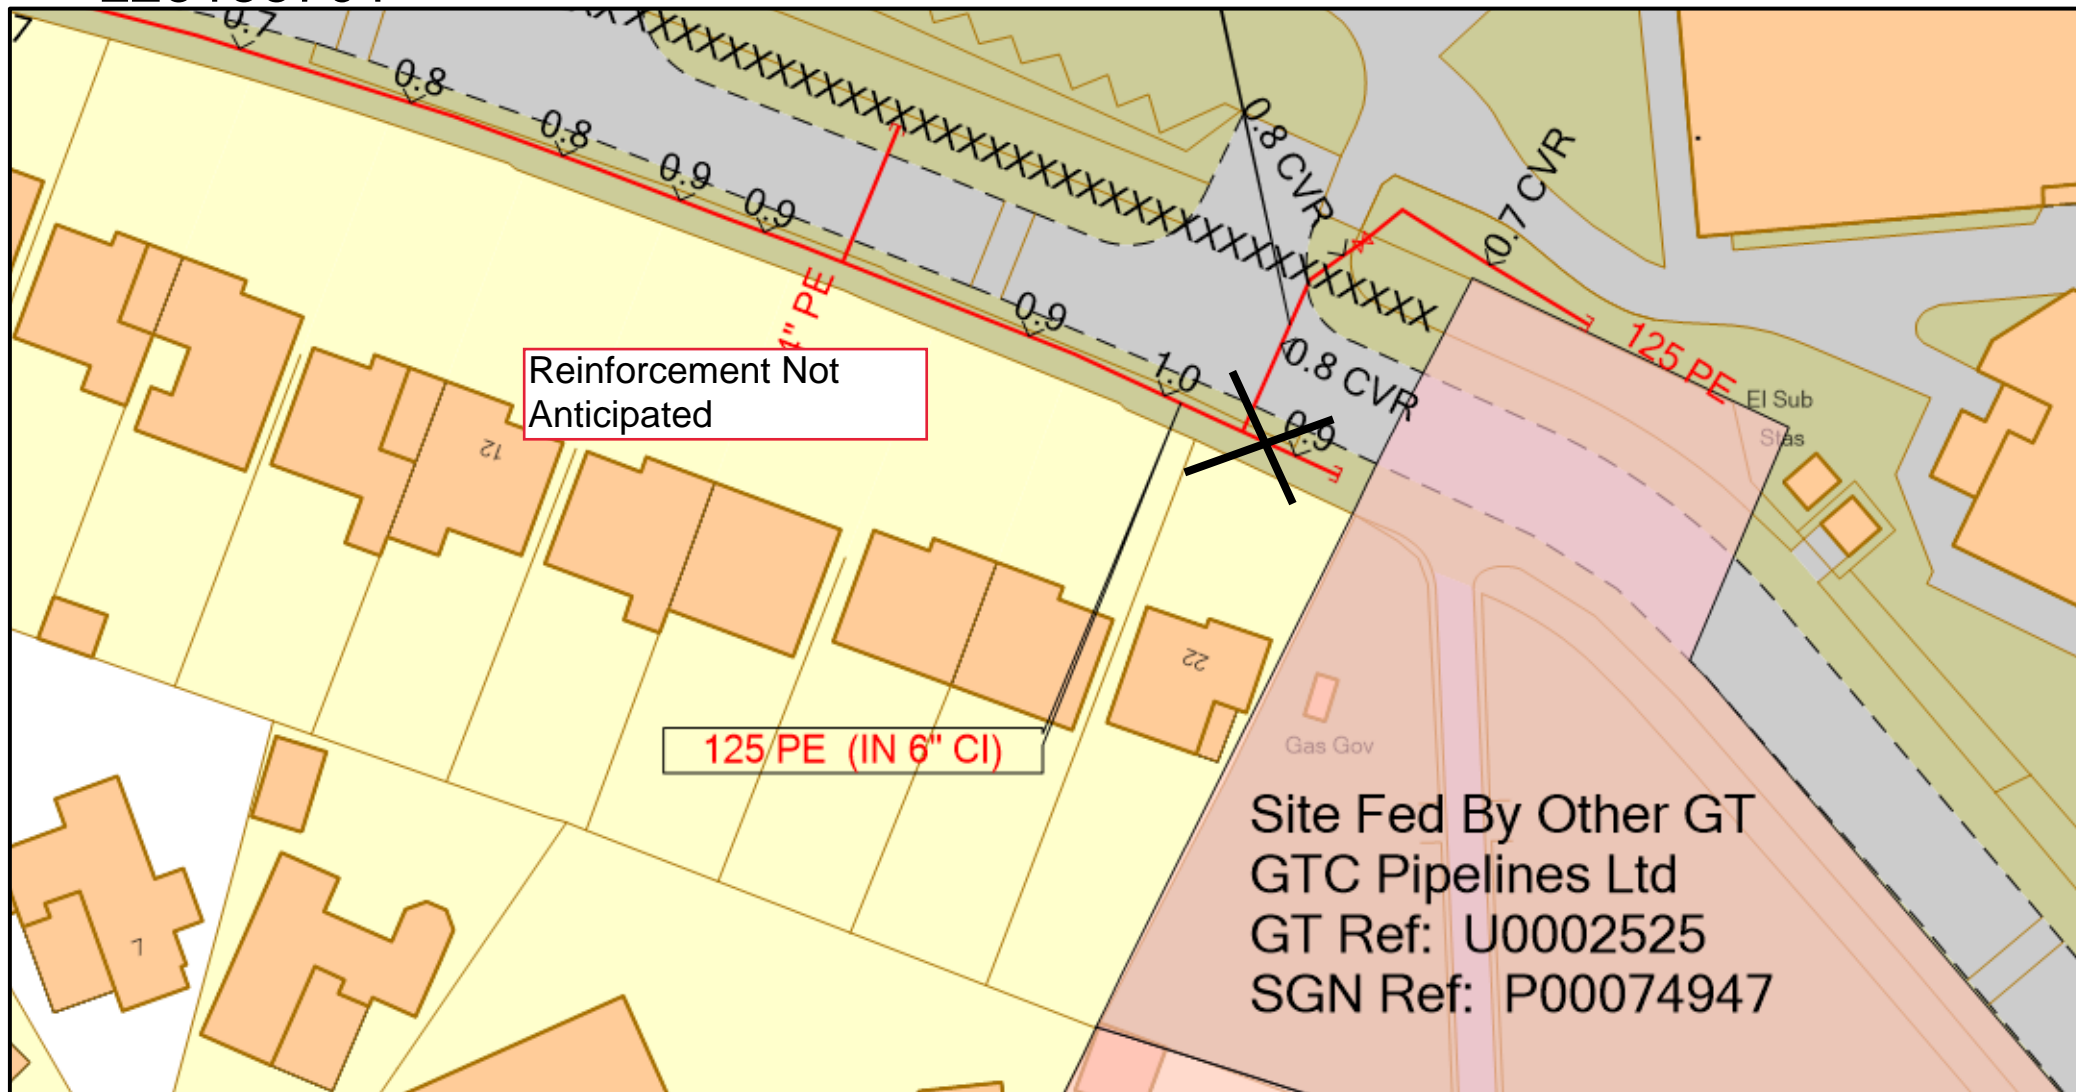

<p>SCALE: 1 : 500</p> <p>USER ID: md70948</p> <p>DATE: 18/07/2023</p> <p>GRID REFERENCE: E590698, N162814, TQ906628</p>	<p>LP MAINS </p> <p>MP MAINS </p> <p>IP MAINS </p> <p>LHP MAINS </p> <p>IGTs SSSIs </p>	<p>This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 08009121722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G) 47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</p> <p>SMELL GAS? CALL 0800 111 999</p>	<p>Map version: 2.12.2</p> <p>Issued by: Scotia Gas Networks Ltd</p> <p>© Crown copyright and database rights 2023 OS 7142104 & 7261731 Background data © OpenStreetMap contributors via the Open Database License.</p> <div data-bbox="1892 1396 2143 1500"> </div>
<p>Some examples of Plant Items</p> <p>Valve Syphon Depth of Cover Diameter Change Material Change </p>			